Residential system requires 1 pump
Commercial system requires 2 pumps

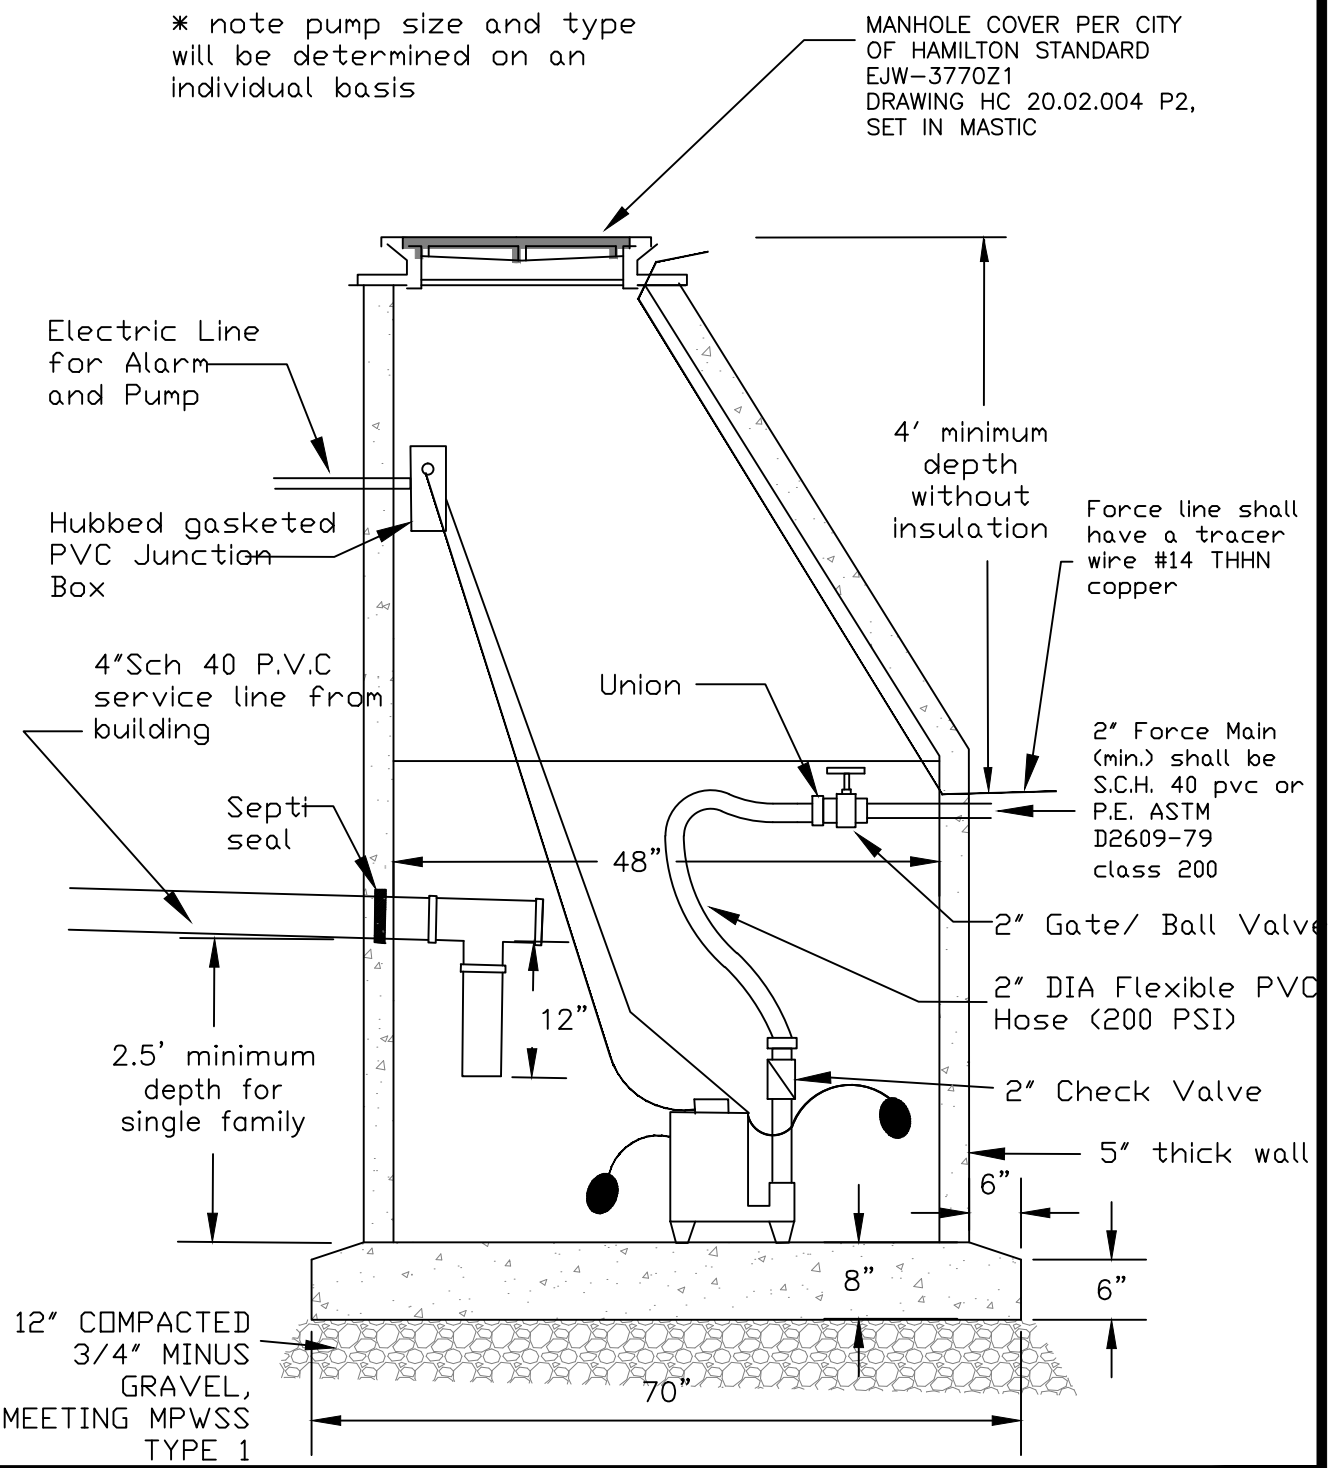


| APPROVED | REVISIONS | CITY OF HAMILTON<br>DEPARTMENT OF PUBLIC WORKS |
|---|---|---|
| | 12/18/2014 | STANDARD<br>EXTERNAL GRINDER PUMP |
| PUBLIC WORKS DIRECTOR | | |
| DATE | | HC. 20.02.006 |