




# DUPLEX SIDEWALK CURB RAMPS – BOULEVARD SIDEWALK

(FOR RADII 15 FT. OR GREATER)

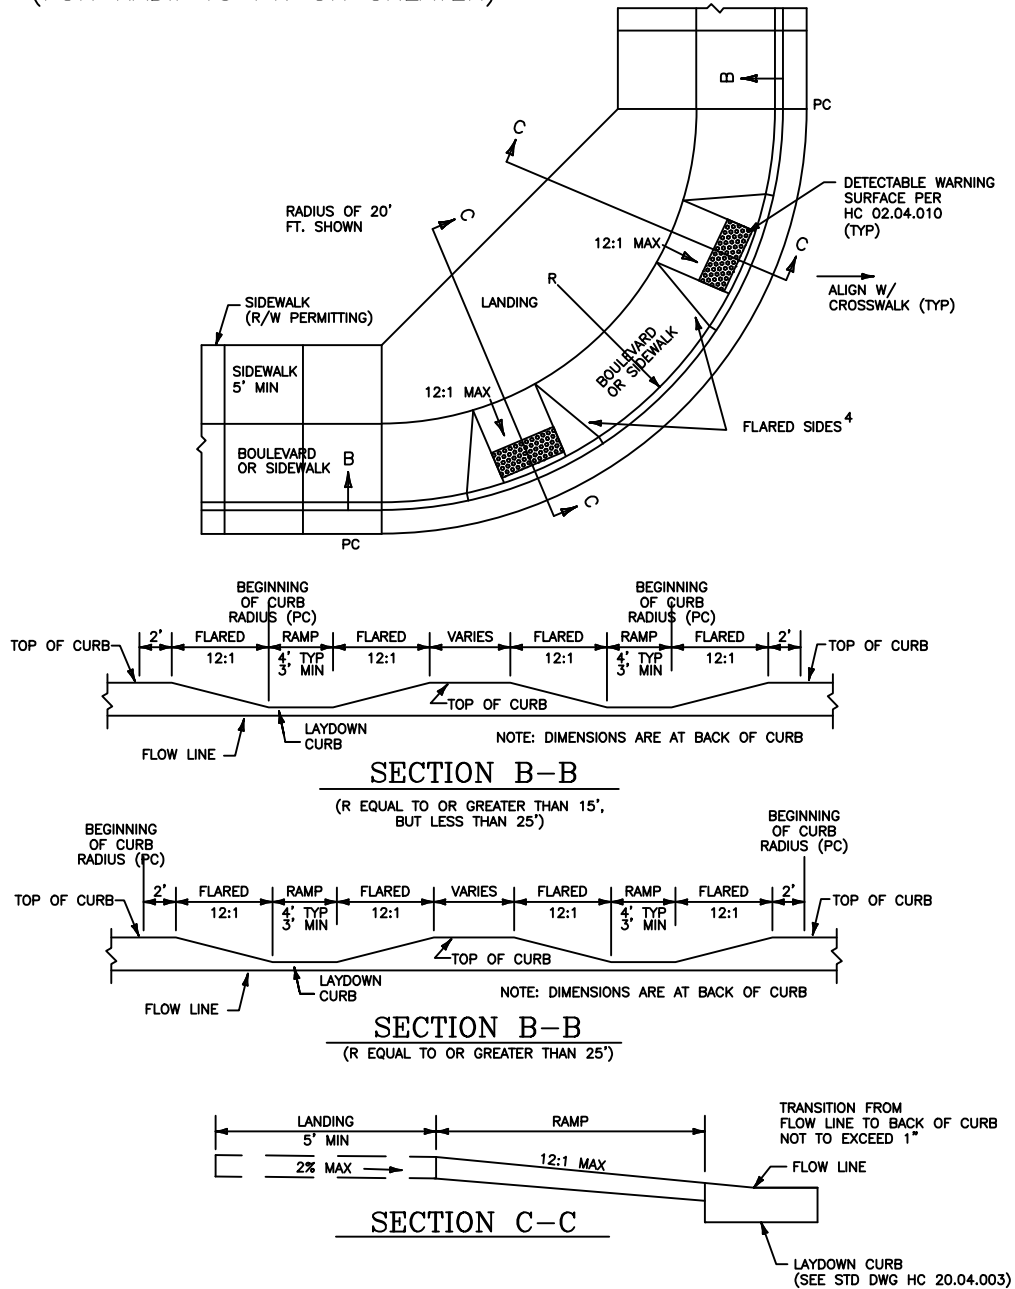

1. THE SURFACE OF THE PUBLIC SIDEWALK RAMP TO CONTRAST VISUALLY WITH THE ADJOINING PUBLIC SIDEWALK SURFACES. THIS CAN BE OBTAINED BY USE OF COLORED CONCRETE, PATTERNING THE CONCRETE SURFACE, OR OTHER APPROVED METHODS.
2. WHERE EXISTING SITE DEVELOPMENT CONDITIONS PROHIBIT THE STRICT AND FULL COMPLIANCE OF ALL ADA CRITERIA, PROVIDE ACCESSIBILITY TO THE MAXIMUM EXTENT FEASIBLE.
3. SEE STD DWG 20.04.002 FOR CONSTRUCTION DETAILS.
4. FLARED SIDES TO BE 1:12 MAX IF WITHIN ADJACENT SIDEWALK, OTHERWISE STANDARD CURB MAY APPLY.



APPROVED	REVISIONS
PUBLIC WORKS DIRECTOR	
DATE	

CITY OF HAMILTON  
DEPARTMENT OF PUBLIC WORKS

DUPLEX SIDEWALK CURB RAMPS  
WITH BOULEVARD SIDEWALK  
PAGE 2 OF 2

H.C. 20.04.021-2