
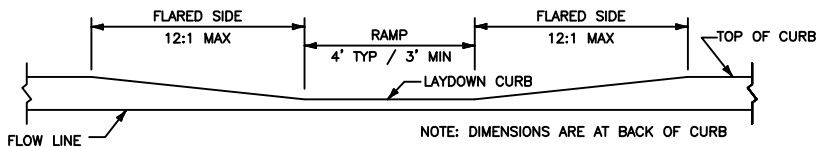



**SINGLE SIDEWALK CURB RAMPS –
BOULEVARD SIDEWALK**

(FOR RADII 15 FT. OR LESS)

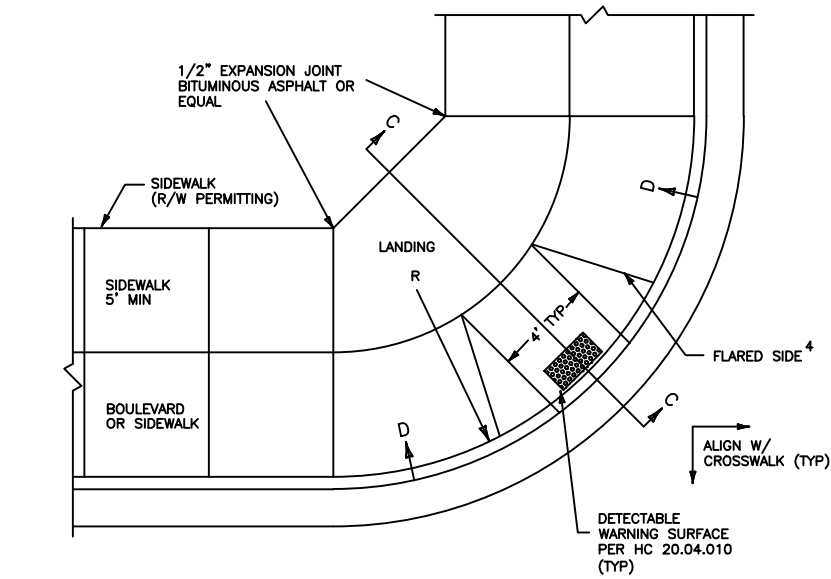

SECTION D-D

(R LESS THAN 15')

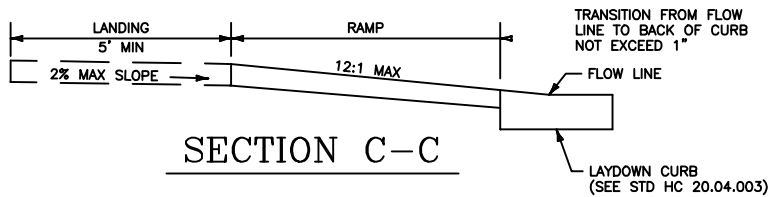

SECTION C-C

NOTE: SINGLE DIAGONAL PUBLIC SIDEWALK CURB RAMPS SERVING TWO STREET CROSSING DIRECTIONS ARE NOT PERMITTED IN NEW CONSTRUCTION.

1. THE SURFACE OF THE PUBLIC SIDEWALK RAMP TO CONTRAST VISUALLY WITH THE ADJOINING PUBLIC SIDEWALK SURFACES. THIS CAN BE OBTAINED BY USE OF COLORED CONCRETE, PATTERNING THE CONCRETE SURFACE, OR OTHER APPROVED METHODS.
2. WHERE EXISTING SITE DEVELOPMENT CONDITIONS PROHIBIT THE STRICT AND FULL COMPLIANCE OF ALL ADA CRITERIA, PROVIDE ACCESSIBILITY TO THE MAXIMUM EXTENT FEASIBLE.
3. SEE STD DWG 20.40.002 FOR BEDDING AND JOINT DETAIL.
4. FLARED SIDES TO BE 1:12 MAX IF WITHIN ADJACENT SIDEWALK.



APPROVED	REVISIONS
	12/18/2014
PUBLIC WORKS DIRECTOR	
DATE	

CITY OF HAMILTON
DEPARTMENT OF PUBLIC WORKS

**SINGLE SIDEWALK CURB RAMPS
BOULEVARD SIDEWALK
PAGE 2 OF 2**

H.C. 20.04.022-2