
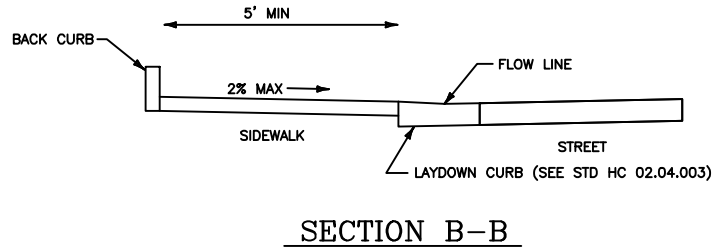


PARALLEL SIDEWALK CURB RAMP

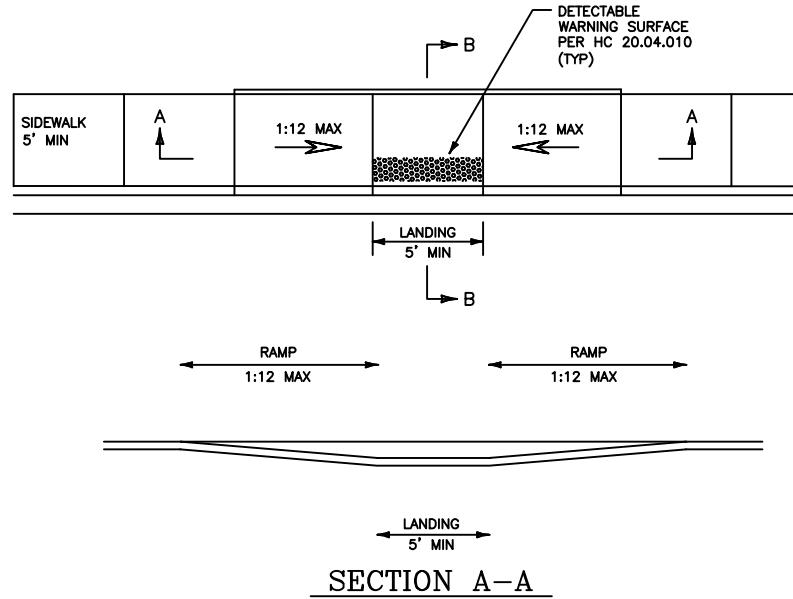

NEW CONSTRUCTION REQUIREMENTS:

1. THE STANDARD AND MINIMUM WIDTH AND LENGTH OF THE LANDING IS 5'X5'.
2. THE STANDARD SLOPE FOR THE CURB RAMPS IS 1:20 OR FLATTER. THE MAXIMUM CURB RAMP SLOPE IS 1:12.
3. THE STANDARD AND MAX CROSS SLOPE OF THE SIDEWALK OR LANDING IS 1:50 (2%).
4. THE SURFACE OF THE LANDING TO CONTRAST VISUALLY WITH ADJOINING PUBLIC SIDEWALK SURFACES. THIS CAN BE OBTAINED BY USE OF COLORED CONCRETE, PATTERNING THE CONCRETE SURFACE, OR OTHER APPROVED METHODS.

REQUIREMENTS FOR ALTERATIONS TO EXISTING FACILITIES:

NOTE: WHEREVER POSSIBLE, ALTER EXISTING FACILITIES TO COMPLY WITH THE NEW CONSTRUCTION REQUIREMENTS.

1. THE STANDARD AND MINIMUM LENGTH AND WIDTH OF THE LANDING IS 5X5' FEET.
2. THE MAXIMUM CURB RAMP SLOPE IS 1:12 PROVIDED THE RISE IS 6 INCHES OR LESS. A 1:12 OR FLATTER SLOPE IS DESIRABLE.
3. THE STANDARD CROSS SLOPE OF THE SIDEWALK AND LANDING IS 1:50 (2%) SLOPE.
4. THE SURFACE OF THE LANDING TO CONTRAST VISUALLY WITH THE ADJOINING PUBLIC SIDEWALK SURFACES. THIS CAN BE OBTAINED BY USE OF COLORED CONCRETE, PATTERNING THE CONCRETE SURFACE, OR OTHER APPROVED METHODS.
5. WHERE EXISTING SITE DEVELOPMENT CONDITIONS PROHIBIT THE STRICT AND FULL COMPLIANCE OF ALL ADA CRITERIA, PROVIDE ACCESSIBILITY TO THE MAXIMUM EXTENT FEASIBLE.
6. SEE STD HC 20.04.002 FOR BEDDING AND JOINT DETAIL.



APPROVED	REVISIONS

CITY OF HAMILTON
DEPARTMENT OF PUBLIC WORKS

PARALLEL SIDEWALK
CURB RAMP

H.C. 20.04.023

PUBLIC WORKS
DIRECTOR

DATE